



TYPICAL TAPPING SLEEVE AND VALVE W/HYDRANT

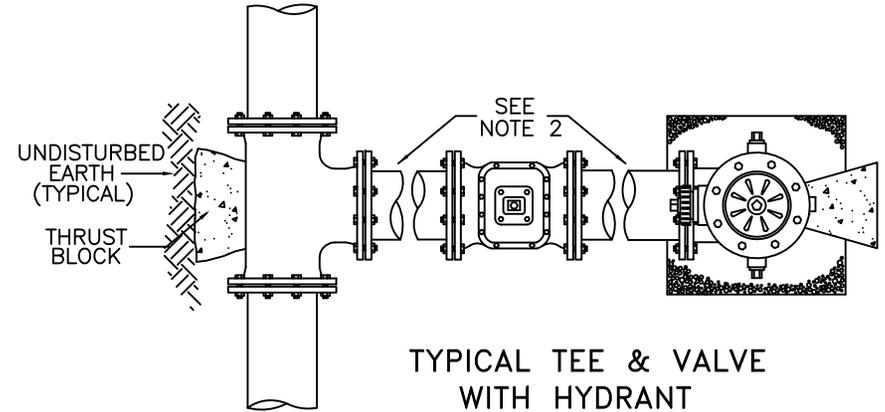

TYPICAL TEE & VALVE WITH HYDRANT

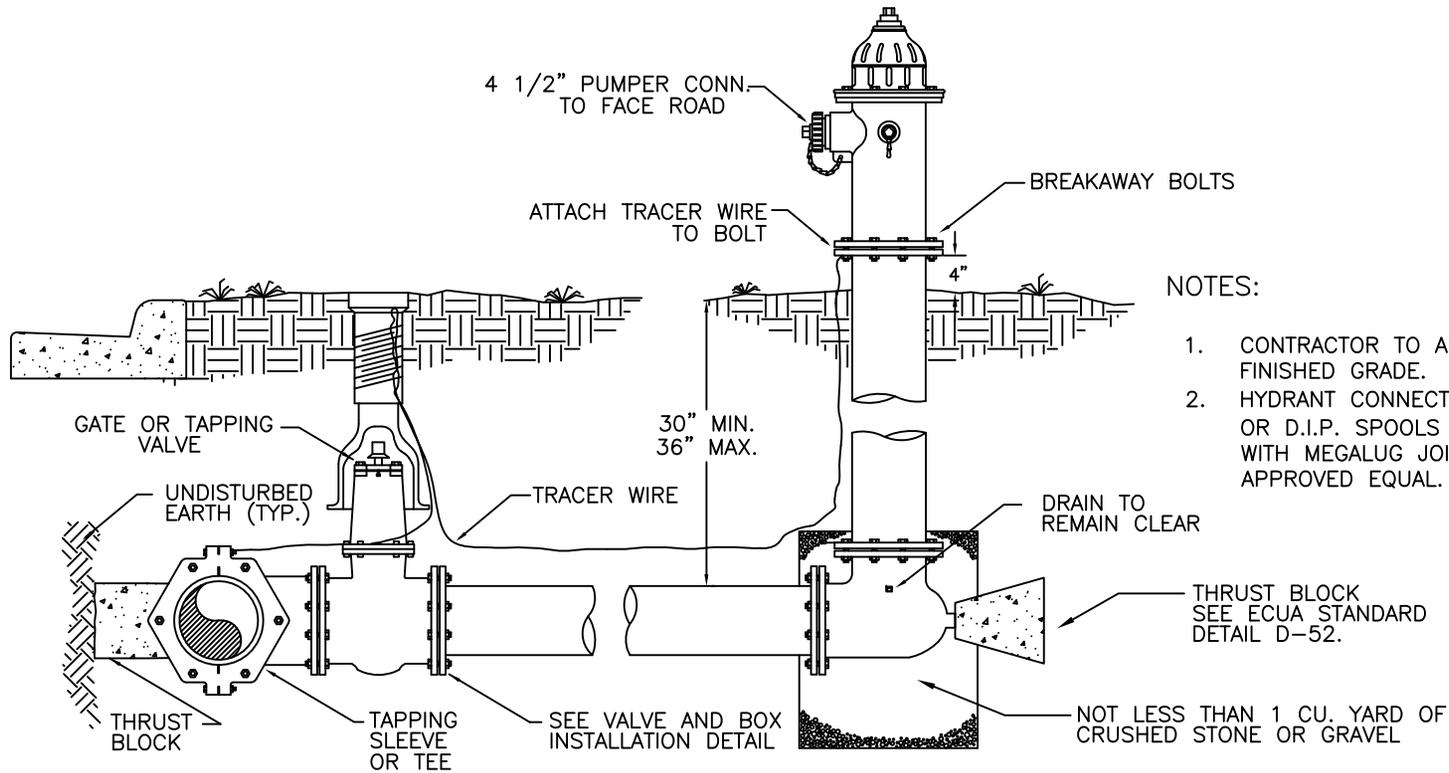

NOTES:

1. CONTRACTOR TO ADJUST FIRE HYDRANT TO FINISHED GRADE.
2. HYDRANT CONNECTORS (MIN 3' IN LENGTH) OR D.I.P. SPOOLS (MIN 3" IN LENGTH) WITH MEGALUG JOINT RESTRAINTS OR APPROVED EQUAL.



DRAFT

SCALE: N.T.S.
DATE: 5/20/14

TYPICAL FIRE HYDRANT INSTALLATION

DETAIL

D-50