
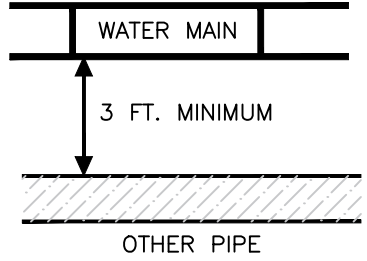
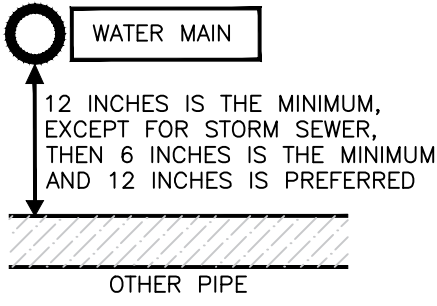
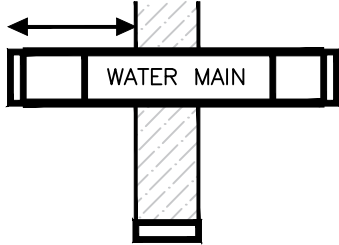
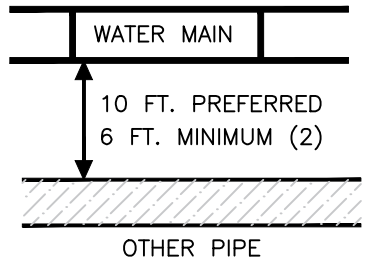
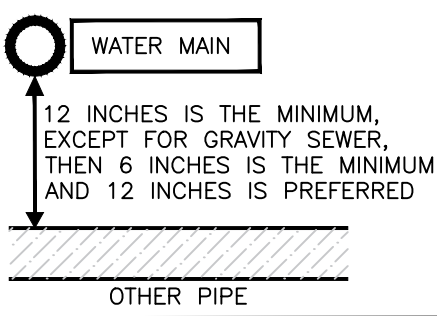


| OTHER PIPE | HORIZONTAL SEPARATION | CROSSINGS (1) | JOINT SPACING • CROSSINGS (FULL JOINT CENTERED) |
|---|---|---|--|
| STORM SEWER, STORMWATER FORCE MAIN |  |  | <p>ALTERNATE 3 FT. MINIMUM</p>  |
| GRAVITY OR PRESSURE SANITARY SEWER, SANITARY SEWER FORCE MAIN |  |  | <p>ALTERNATE 6 FT. MINIMUM</p>  |

- (1) WATER MAIN SHOULD CROSS ABOVE OTHER PIPE. WHEN WATER MAIN MUST BE BELOW OTHER PIPE, THE MINIMUM SEPARATION IS 12 INCHES.
(2) 3 FT. GRAVITY SANITARY SEWER WHERE THE BOTTOM OF THE WATER MAIN IS LAID AT LEAST 6 INCHES ABOVE THE TOP OF THE GRAVITY SANITARY SEWER.

NOTES:

- A. INFORMATION PROVIDED FROM FDEP RULE 62-555. IF OTHER FDEP RULES CONFLICT, THEN USE THE MOST STRINGENT RULE.
B. IF THERE ARE CONFLICTS IN THE SEPARATION REQUIREMENTS BETWEEN COLLECTION SYSTEMS AND DRINKING WATER FACILITIES ESTABLISHED IN FOOTNOTES (1) AND (2) ABOVE AND THOSE ESTABLISHED IN CHAPTER 62-532 OR 62-555, F.A.C., THEN THE REQUIREMENTS IN CHAPTER 62-532 OR 62-555, F.A.C., SHALL APPLY.

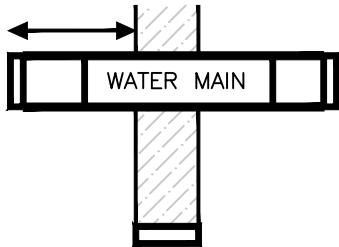

SCALE: N.T.S.
DATE: 9/01/2016

WATER / SEWER
SEPARATION

DETAIL
D-64