


Instructions:
Include this Sheet as shown.

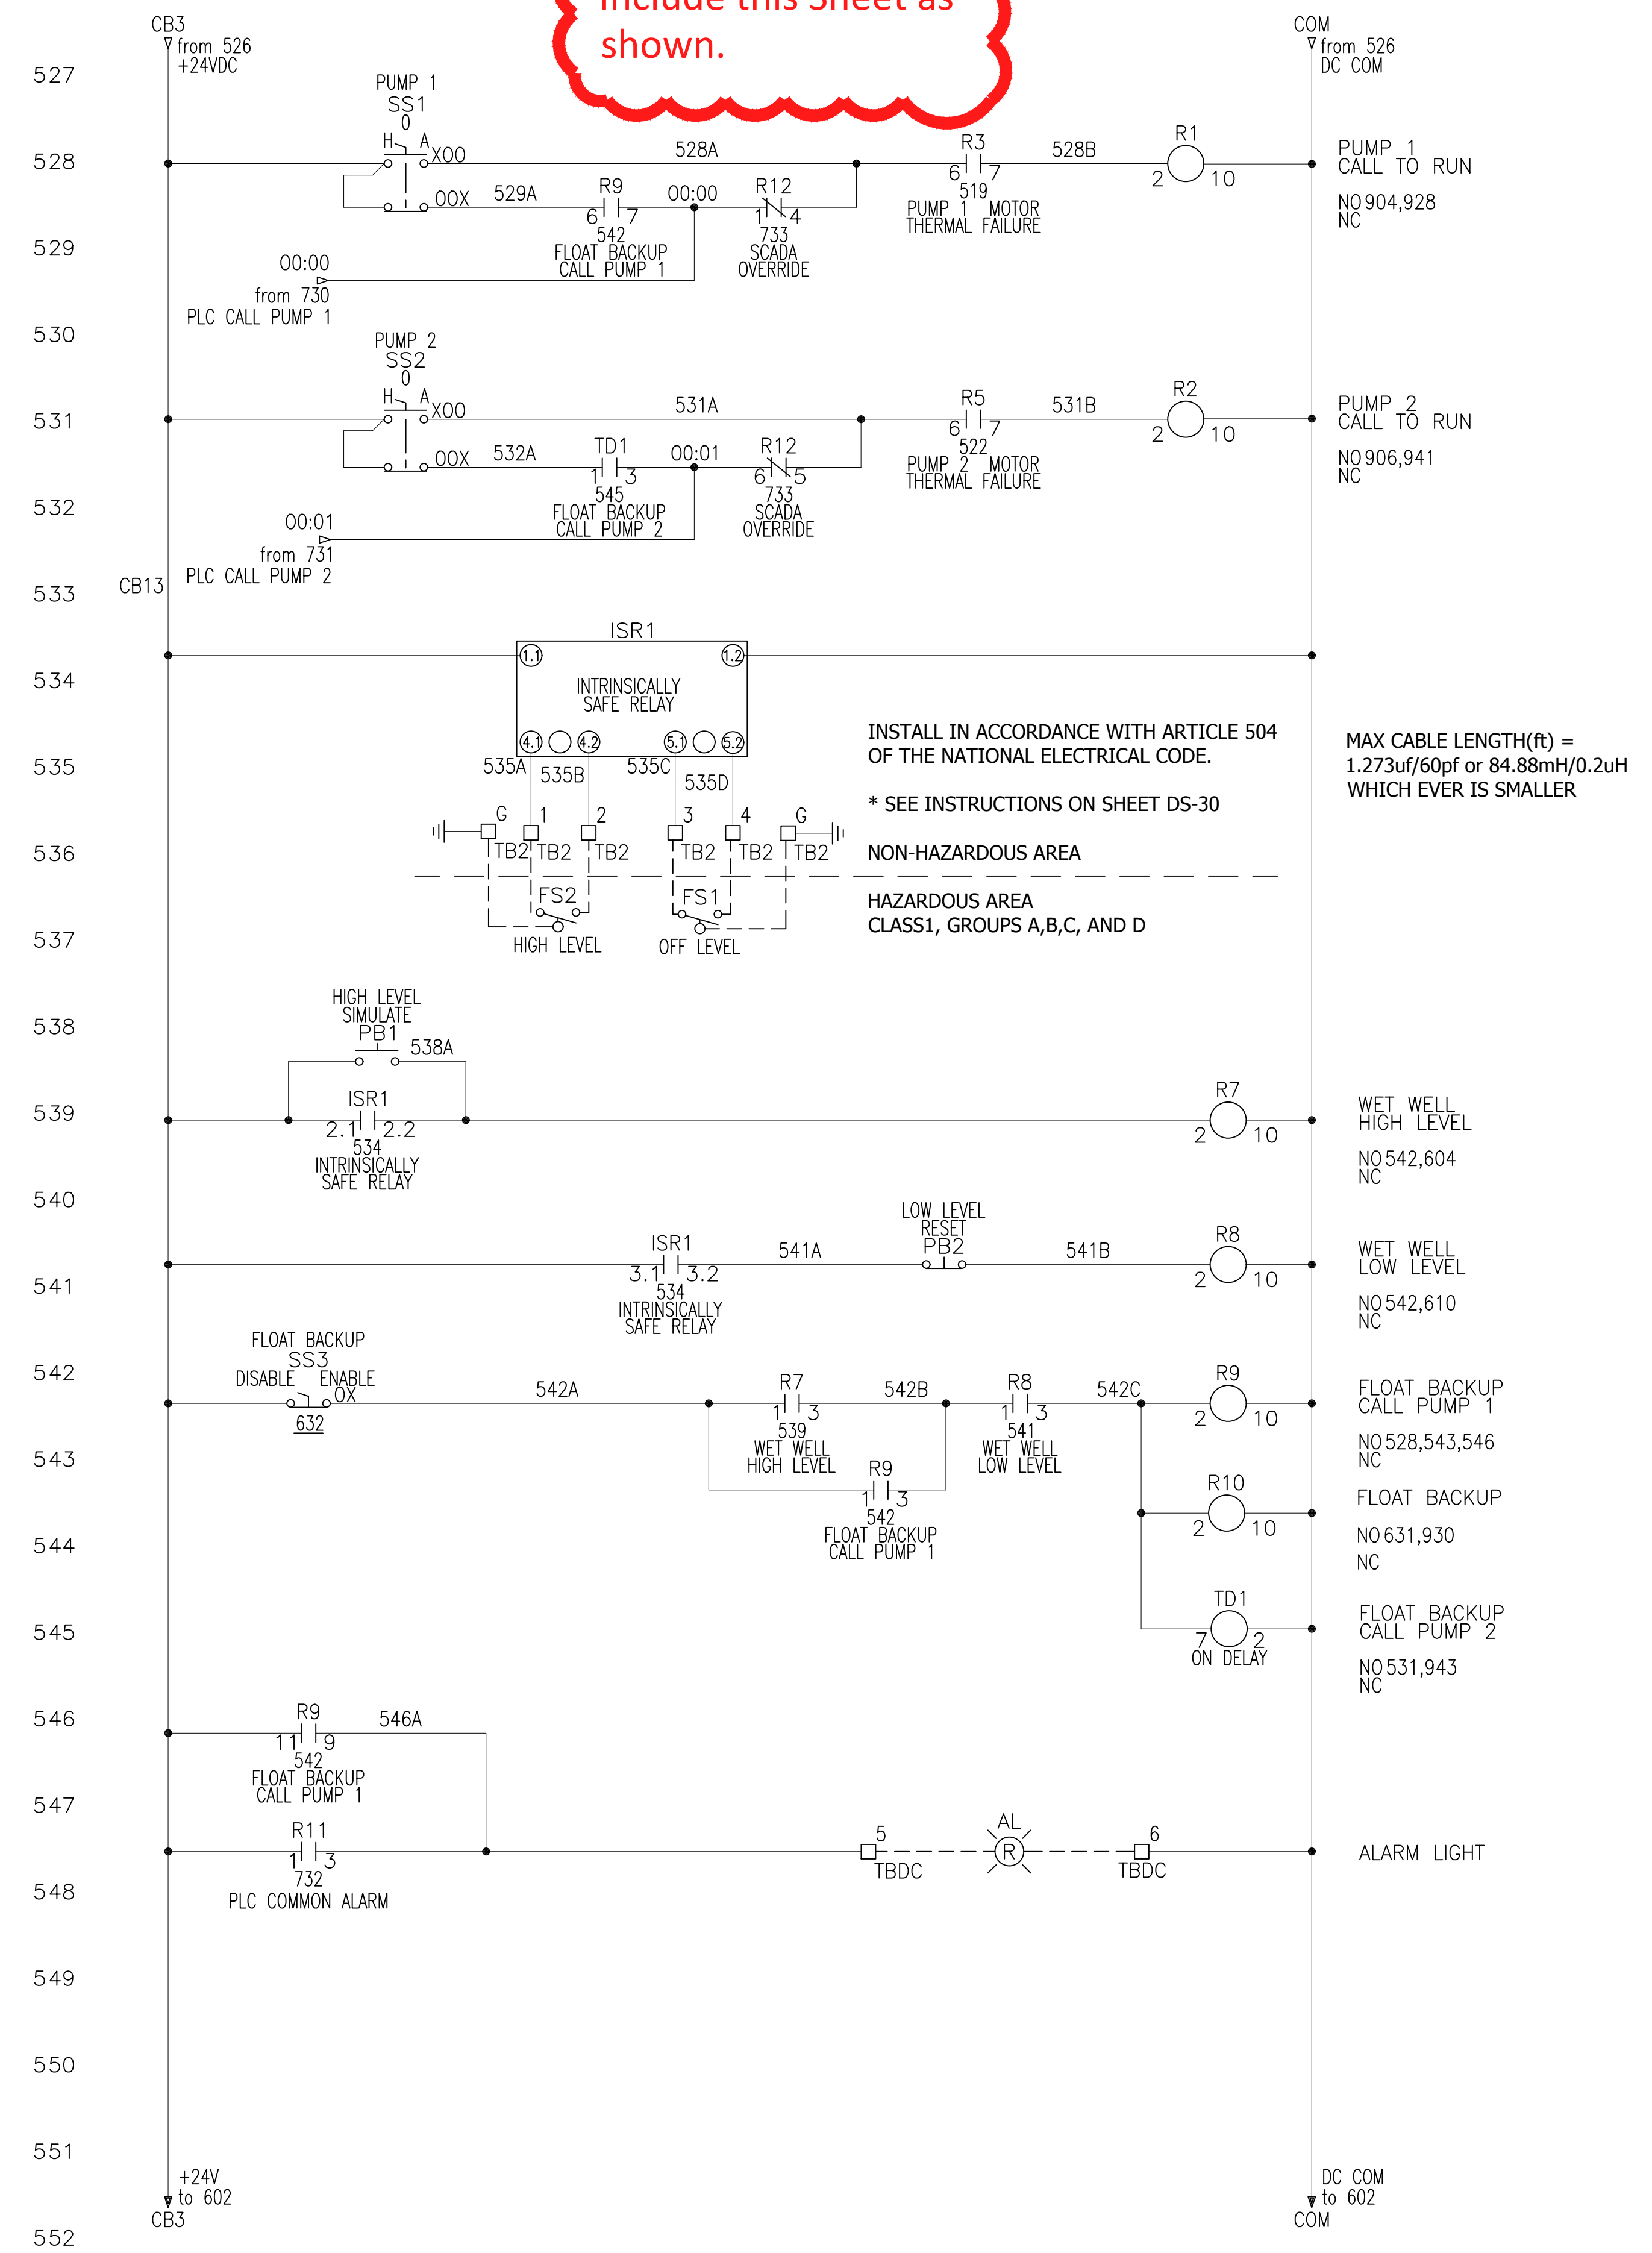

INSTALL IN ACCORDANCE WITH ARTICLE 504 OF THE NATIONAL ELECTRICAL CODE.

* SEE INSTRUCTIONS ON SHEET DS-30

NON-HAZARDOUS AREA

HAZARDOUS AREA CLASS1, GROUPS A,B,C, AND D

MAX CABLE LENGTH(L) = 1.273uf/60pf or 84.88mH/0.2uH WHICH EVER IS SMALLER

Control Panel - Schematic.dwg



SHEET NO. DS-22

DATE: 9/01/2016

SEE NOTE #10 ON SHEET DS-0.1