


Instructions:
 Select this sheet for abutting panel layouts with VFD starter type.

PANEL NOTES





1. SEE SHEET DS-34 FOR LEGENDS AND TAGS.
2. GENERATOR RECEPTACLE AND POWER PANEL TO BE ON THE DRIVEWAY-SIDE OF THE ENCLOSURES.

FRAMEWORK NOTES


1. TOP AND BOTTOM OF BASE TO BE LEFT OPEN.
2. DRILL TOP OF BASE TO ATTACH ENCLOSURES AS REQUIRED.
3. DRILL BOTTOM OF BASE TO ATTACH TO SLAB AS REQUIRED.

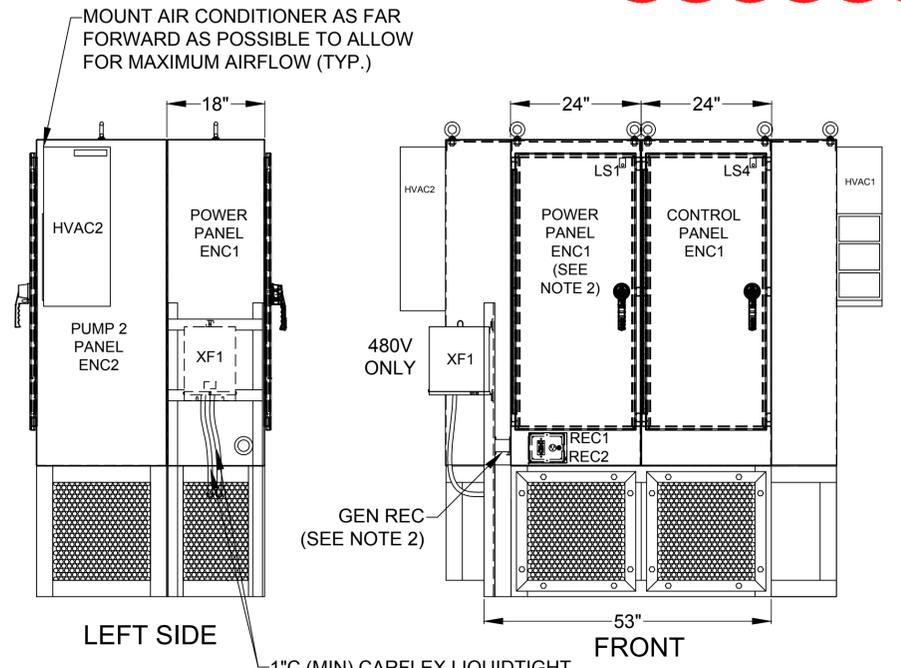

1" (MIN) CARFLEX LIQUIDTIGHT FLEXIBLE NONMETALLIC CONDUIT FOR PRIMARY AND SECONDARY TRANSFORMER CONDUCTORS

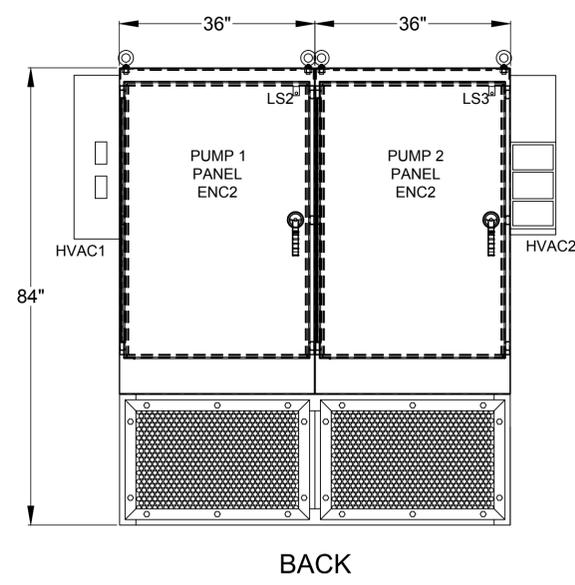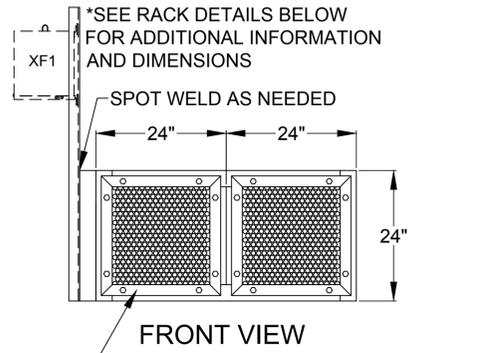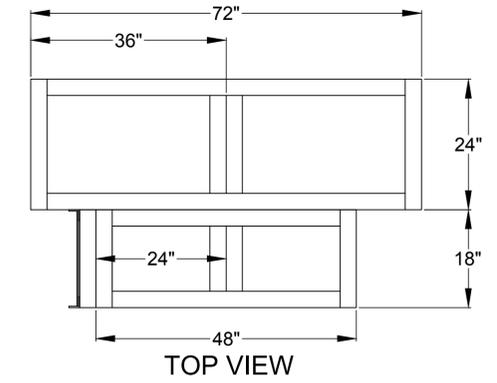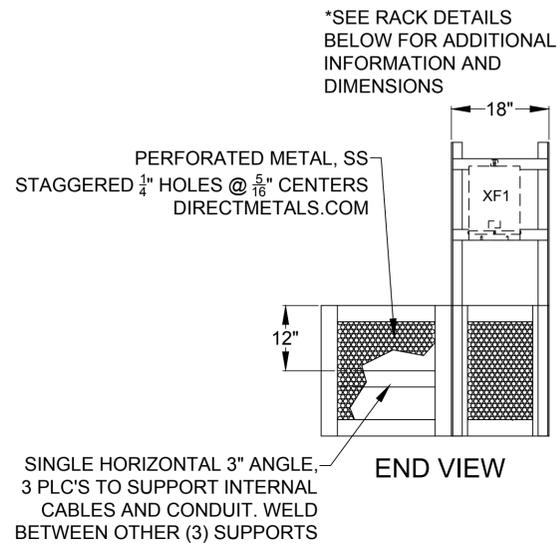


ABUTTING EXTERIOR PANEL AND CONDUIT LAYOUTS

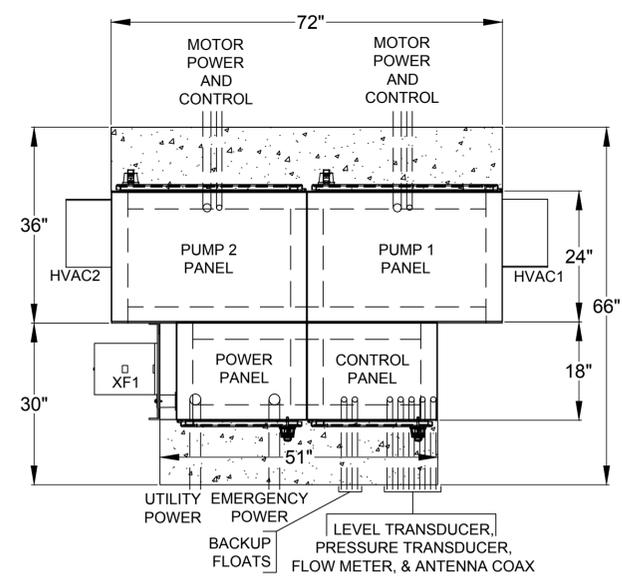


OVERHEAD

Instructions:
 Include Transformer and Rack for 480V systems only, and remove for 208V/240V systems.


FRONT OF BASE WILL HAVE REMOVABLE PANELS AT EACH OPENING AS SHOWN, ATTACH SCREENS TO BACK SIDE OF REMOVABLE PANELS.

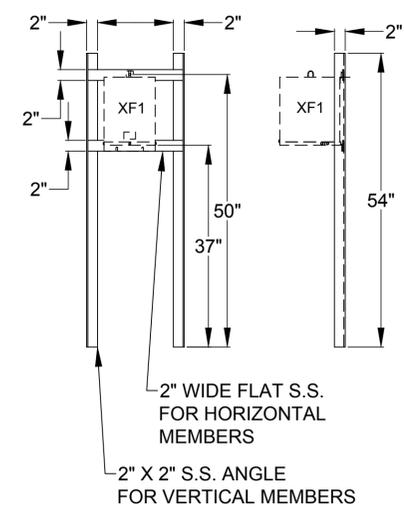

FRONT & SIDE VIEWS (480V ONLY) RACK DETAILS

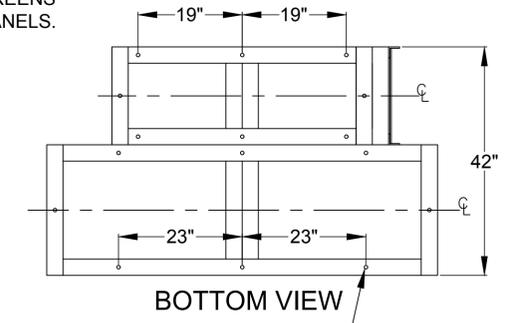

BOTTOM VIEW

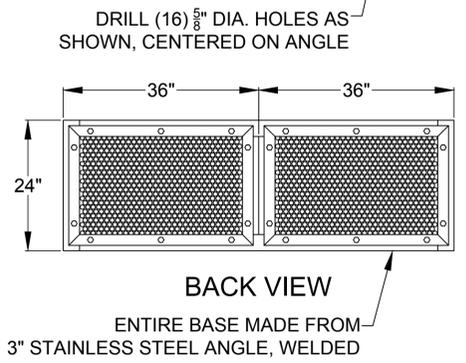

BACK VIEW

BASE FRAMEWORK LAYOUT

