



TYPICAL SHORT SERVICE

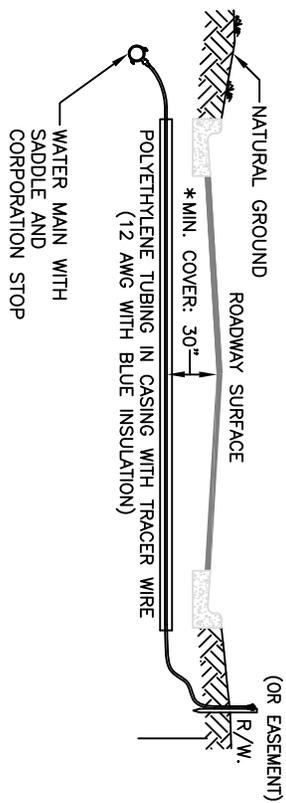

TYPICAL LONG SERVICE - STREET CROSSING

- GENERAL NOTES:**
- SERVICE LINES TO BE TERMINATED WITHIN 2 FEET OF THE R/W LINE BUT NOT UNDER ANY TYPE OF PAVEMENT.
 - ALL WATER SERVICES SHALL BE INSTALLED 1 FOOT OFF THE COMMON PROPERTY LINE, ON THE OPPOSITE PROPERTY LINE FROM THE PROPOSED ELECTRICAL TRANSFORMERS. THE OWNER/DEVELOPER SHALL COORDINATE THE LOCATION OF THE WATER METER WITH THE POWER COMPANY PRIOR TO INSTALLATION.
 - CASING SHALL BE PVC OR HDPE AND SHALL BE COLOR CODED BLUE OR BLACK WITH BLUE STRIPING.
 - ALL METER BOXES AND PLUMBING SHALL BE INSTALLED BY THE OWNER/DEVELOPER. ALL METERS SHALL BE INSTALLED BY ECUA BY CONNECTING METER TO CURB-STOP.

RECOMMENDED TUBING SIZES FOR WATER SERVICES		
SIZE OF FLOW METER (GPM)	DESIGN FLOW (GPM)	MAX. LENGTH OF TUBING FOR SIZE INDICATED
3/8"	20	1" 2"
1"	50	17 492
1 1/2"	100	136
SIZE OF CASING (LONG SERVICE ONLY)		2" 4"

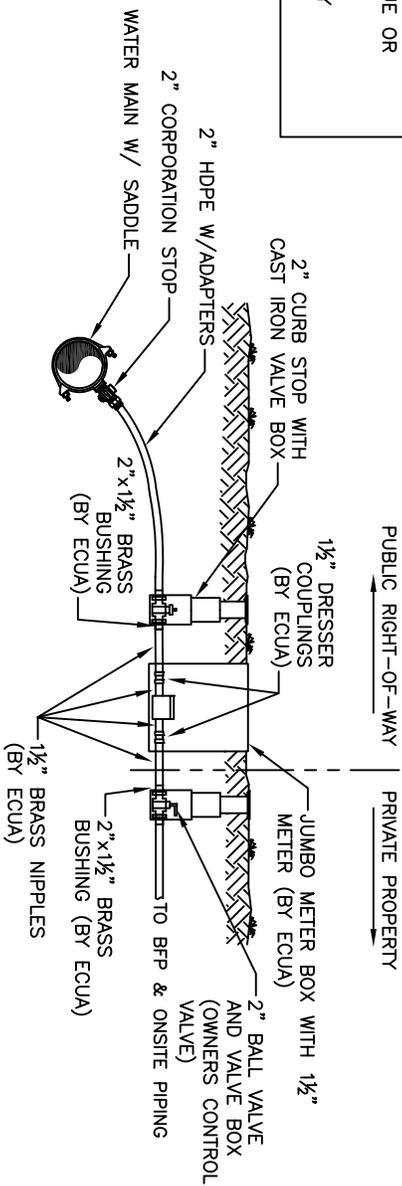

1 1/2" WATER METER ASSEMBLY



EMPIRE STATE UTILITY AUTHORITY
 SCALE: N.T.S.
 DATE: 12/18/14

PROPOSED WATER SERVICE FOR 5/8", 1", & 1 1/2" METERS

DETAIL
D-40