
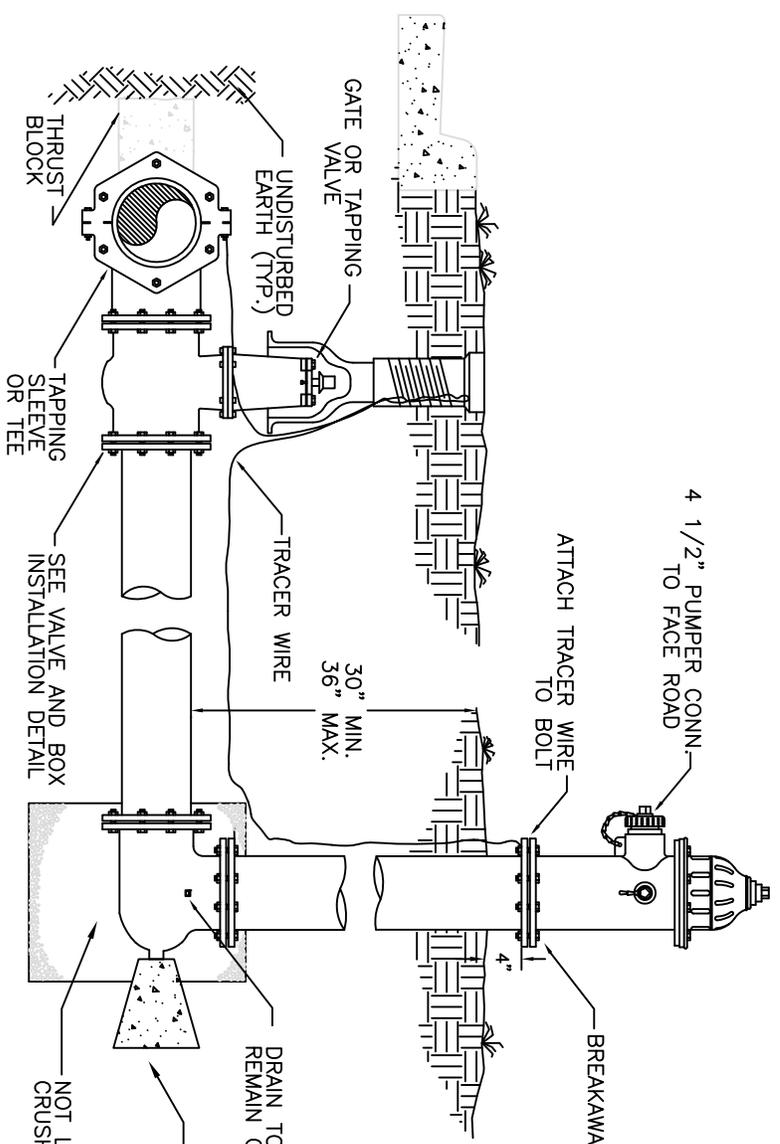


TYPICAL FIRE HYDRANT INSTALLATION

DETAIL

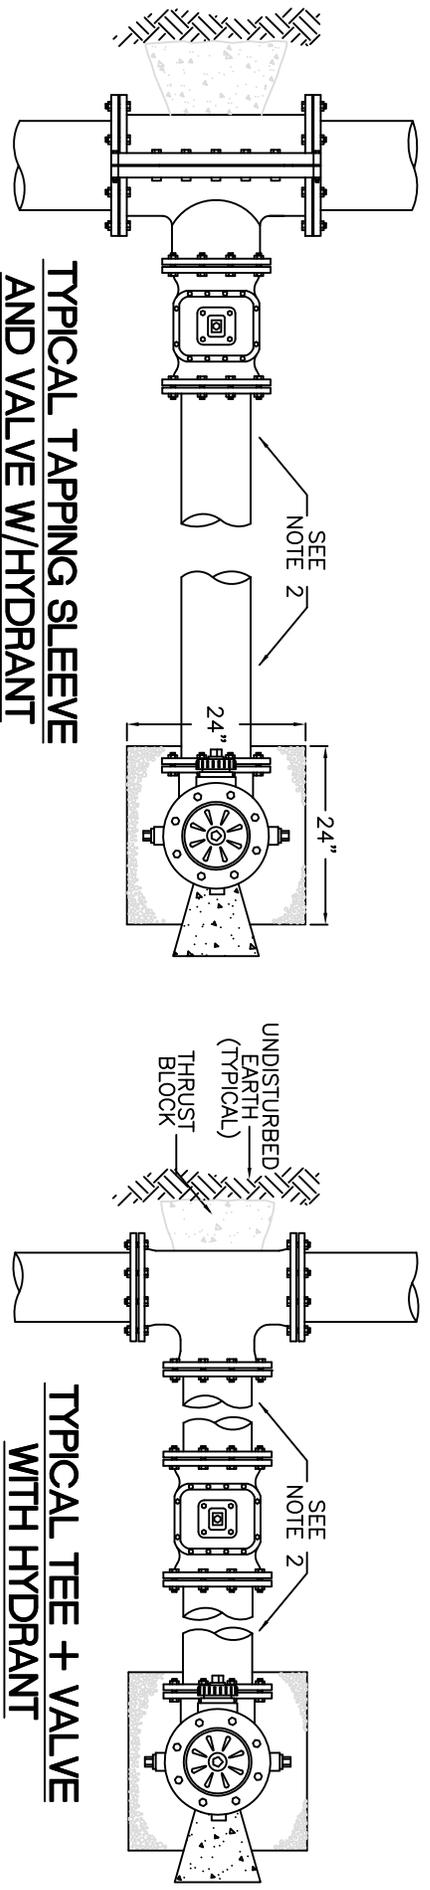

- NOTES:
1. CONTRACTOR TO ADJUST FIRE HYDRANT TO FINISHED GRADE.
 2. HYDRANT CONNECTORS (MIN 3' IN LENGTH) OR D.I.P. SPOOLS (MIN 3" IN LENGTH) WITH MEGALUG JOINT RESTRAINTS OR APPROVED EQUAL.

4" BREAKAWAY BOLTS

4 1/2" PUMPER CONN. TO FACE ROAD

ATTACH TRACER WIRE TO BOLT

30" MIN. 36" MAX.

THRUST BLOCK

UNDISTURBED EARTH (TYPICAL)

THRUST BLOCK

SEE ECUA STANDARD DETAIL D-52.

THRUST BLOCK

NOT LESS THAN 1 CU. YARD OF CRUSHED STONE OR GRAVEL

DRAIN TO REMAIN CLEAR