
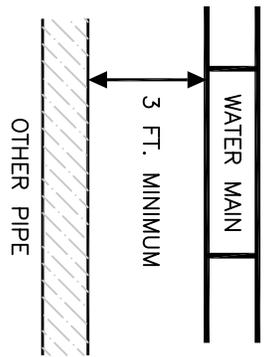
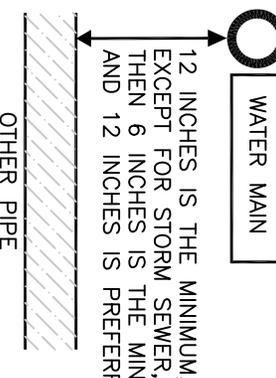
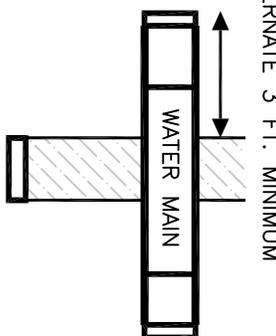
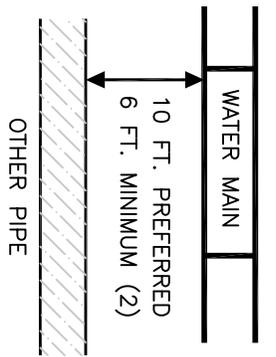
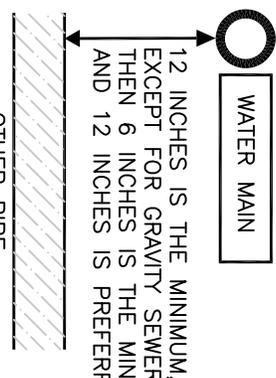


| OTHER PIPE | HORIZONTAL SEPARATION | CROSSINGS (1) | JOINT SPACING • CROSSINGS (FULL JOINT CENTERED) |
|--|---|---|---|
| STORM SEWER, FORCE MAIN SANITARY SEWER |  |  |  |
| GRAVITY OR PRESSURE SANITARY SEWER, FORCE MAIN |  |  |  |

- (1) WATER MAIN SHOULD CROSS ABOVE OTHER PIPE. WHEN WATER MAIN MUST BE BELOW OTHER PIPE, THE MINIMUM SEPARATION IS 12 INCHES.
- (2) 3 FT. GRAVITY SANITARY SEWER WHERE THE BOTTOM OF THE WATER MAIN IS LAID AT LEAST 6 INCHES ABOVE THE TOP OF THE GRAVITY SANITARY SEWER.

NOTES:

- A. INFORMATION PROVIDED FROM FDEP RULE 62-555. IF OTHER FDEP RULES CONFLICT, THEN USE THE MOST STRINGENT RULE.
- B. IF THERE ARE CONFLICTS IN THE SEPARATION REQUIREMENTS BETWEEN COLLECTION SYSTEMS AND DRINKING WATER FACILITIES ESTABLISHED IN FOOTNOTES (1) AND (2) ABOVE AND THOSE ESTABLISHED IN CHAPTER 62-532 OR 62-555, F.A.C., THEN THE REQUIREMENTS IN CHAPTER 62-532 OR 62-555, F.A.C., SHALL APPLY.

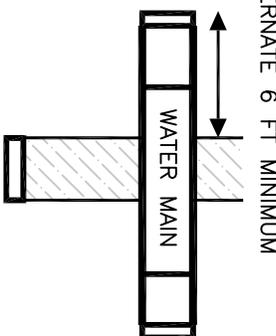

PROPOSED
 SCALE: N.T.S.
 DATE: 12/18/14

**WATER / SEWER
 SEPARATION**

DETAIL

D-64