



**TYPICAL TAPPING SLEEVE  
AND VALVE W/HYDRANT**

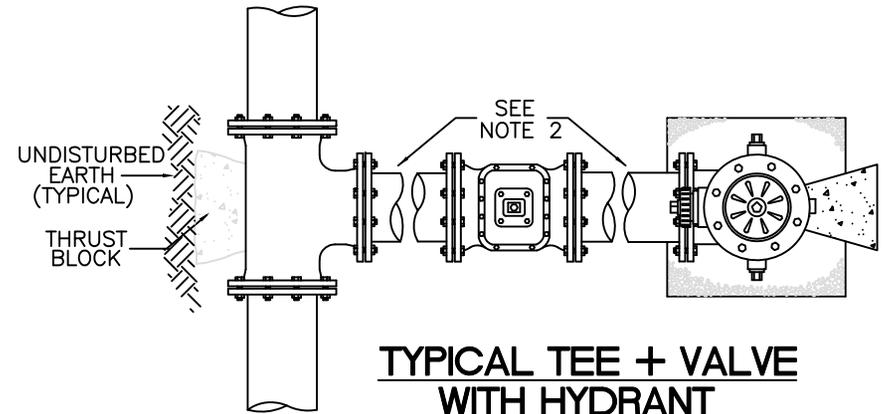

**TYPICAL TEE + VALVE  
WITH HYDRANT**

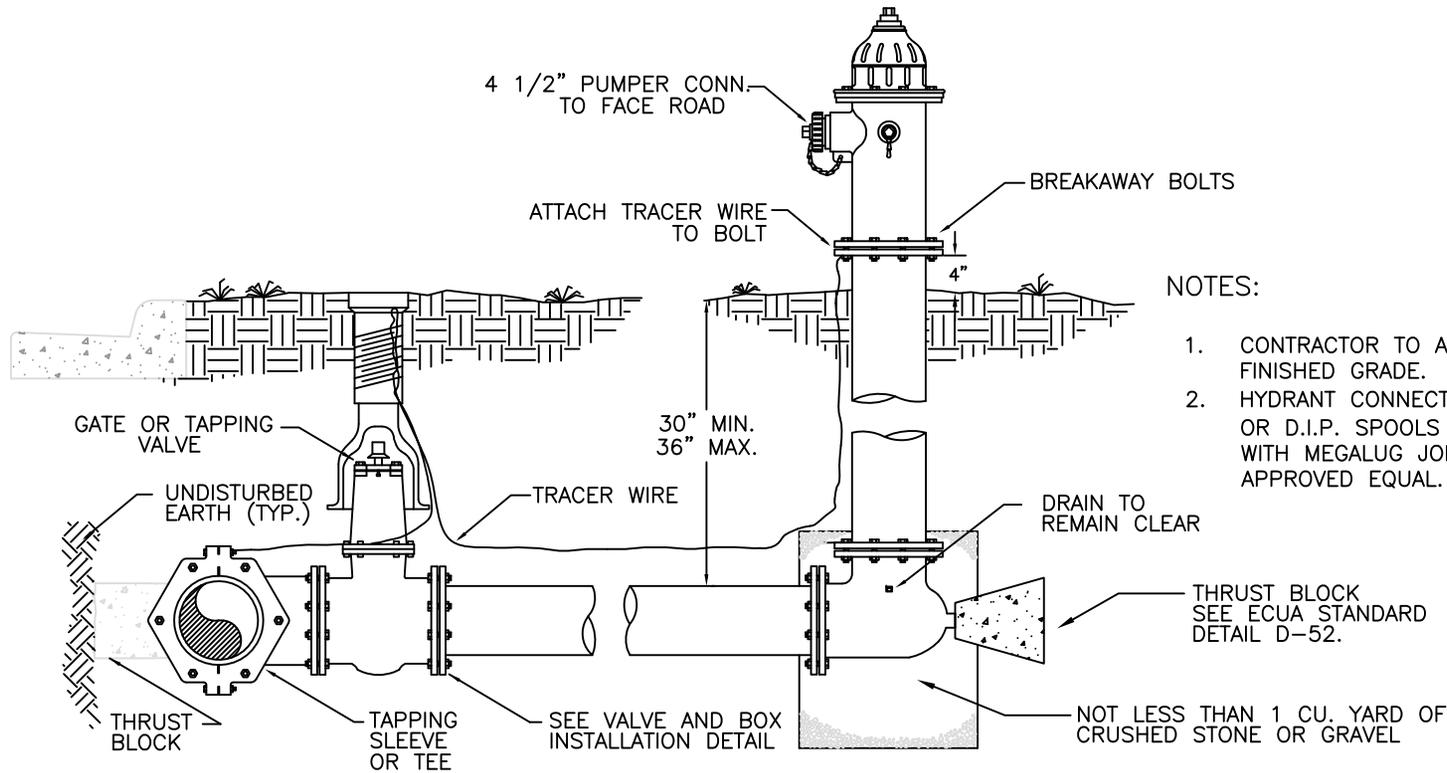

**NOTES:**

1. CONTRACTOR TO ADJUST FIRE HYDRANT TO FINISHED GRADE.
2. HYDRANT CONNECTORS (MIN 3' IN LENGTH) OR D.I.P. SPOOLS (MIN 3" IN LENGTH) WITH MEGALUG JOINT RESTRAINTS OR APPROVED EQUAL.

**TYPICAL FIRE HYDRANT  
INSTALLATION**

DETAIL

**D-50**



SCALE: N.T.S.  
DATE: 12/18/14